




Chuckanut Bay/Mud Bay Water Quality Monitoring Summary

Water Quality Status 8/22/06-9/16/09

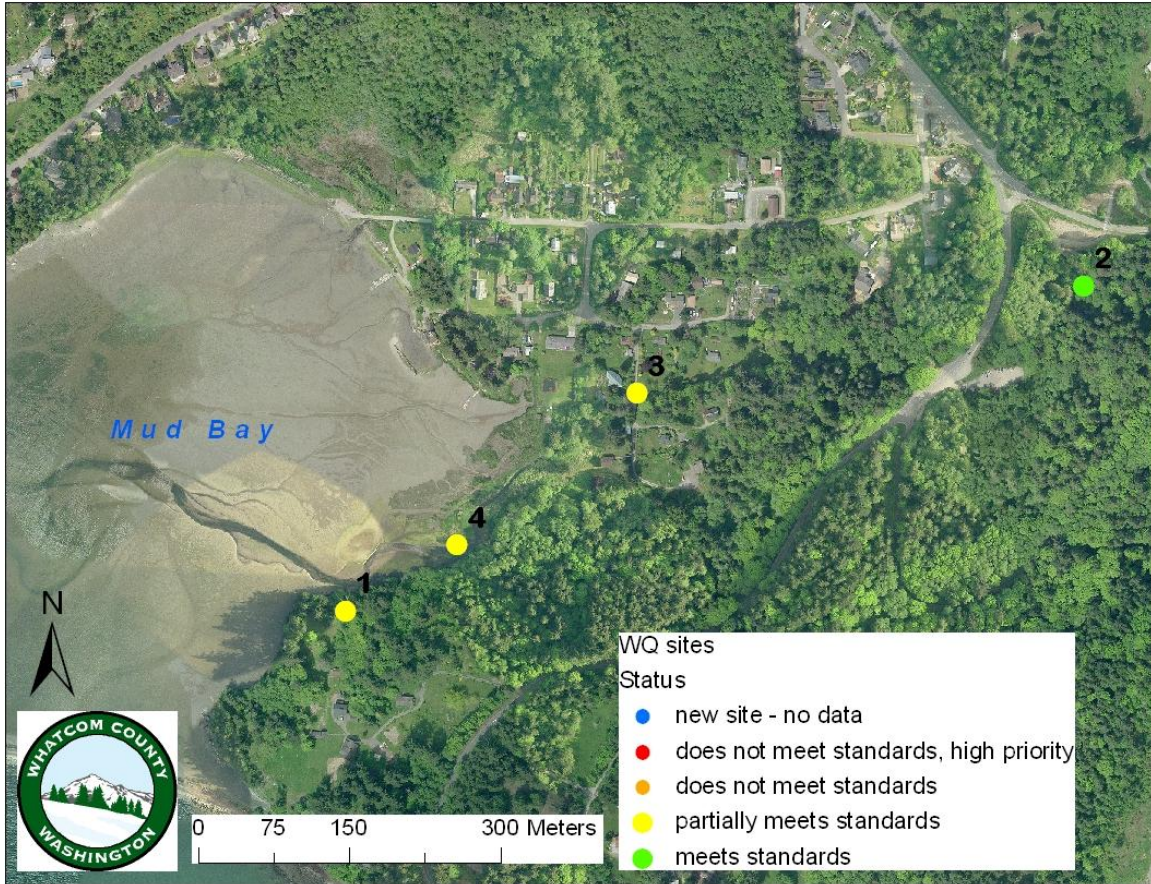

Site	Number of samples	GeoMean (cfu/100ml)	Minimum (cfu/100ml)	Maximum (cfu/100ml)	% of samples > 200 (cfu/100ml)	Status
CB1	28	37	1	15400	21	●
CB2	34	29	1	1470	6	●
CB3	34	53	1	1800	26	●
CB4	30	50	3	328	33	●

Washington State Fecal Coliform Standards for Fresh Water Draining into Chuckanut Bay Waters:

- Geometric mean <100 colonies/100mL
- No more than 10% of the samples > 200 colonies/100mL